

Project Name: **454B Stock**

Unit Model #: **KQG06E4B1AA5A111A1**

Quantity: **1**

System: **KQG06E4B1AA5A111A1**

Cooling Performance

Total gross capacity	64.5 MBH
Sensible gross capacity	46.8 MBH
Seasonal Efficiency (at ARI)	14.00 SEER2
Efficiency (at ARI)	EER
Efficiency (at ARI)	12.00 EER2
Ambient DB temp.	95.0 °F
Entering DB temp.	80.0 °F
Entering WB temp.	67.0 °F
Evap Coil Leaving DB temp.	58.3 °F
Evap Coil Leaving WB temp.	56.7 °F
Unit Leaving DB temp.	59.9 °F
Unit Leaving WB temp.	57.3 °F
Leaving air temp dew point	55.70 °F
Power input (w/o blower)	4.30 kW
Sound power	80 dB(a)

Refrigerant

Refrigerant type	R-454B
Sys1	4 lb 14 oz

Gas Heating Performance

Entering DB temp.	60 °F
Heating output capacity (Max)	90.0 MBH
Supply air	2000 cfm
Heating input capacity (Max)	112 MBH
Leaving DB temp.	101.7 °F
Air temp. rise	41.7 °F
SSE	80.0 %
Stages	1

Supply Air Blower Performance

Supply air	2000 cfm
Ext. static pressure	0.6 IWG
Blower speed	1094 rpm
Max BHP of Motor (including service factor)	2.40 HP
Duct location	Bottom
Motor rating	2.40 HP
Actual required BHP	1.04 HP
Power input	0.97 kW
Elevation	0 ft
Drive type	BELT

Electrical Data

Power supply	460-3-60
Unit min circuit ampacity	12.2 A
Unit min over-current protection	15 A
Unit max over-current protection	15 A

Dimensions & Weight

Hgt 41 in	Len 74 in	Wth 49 in
Weight with factory installed options	625 lb	

Clearances

Right	18 in	Front	36 in	Rear	18 in
Top	72 in	Bottom	1 in	Left	12 in

Note: Please refer to the tech guide for listed maximum static pressures



Unit Features

- Refrigerant Detection System (RDS) is Factory Installed
- Single Stage Cooling
- 112 MBH Single Stage Input Medium Heat Aluminized Gas
- Unit Cabinet Constructed of Powder Painted Steel, Certified At 750 Hours Salt Spray Test (ASTM B-117 Standards)
- Either supply and/or return can be field converted from vertical to horizontal configuration without cutting panels.
- Full perimeter base rails with built in rigging capabilities
- Scroll Compressors
- Medium Static Belt Drive Blower
- Unit Ships with 2" Throwaway Filters
- Solid Core Liquid Line Filter Driers
- Single Point Power Connection
- Short Circuit Current: 5kA RMS Symmetrical
- Microchannel All Aluminum Condenser Coil, Copper tube/Aluminum fin Evaporator Coil

5 Ton

- All units are manufactured at an ISO 9001 registered facility and each rooftop is completely computer-run tested prior to shipment.

BAS Controller

- Smart Equipment Controller including Discharge Air, Return Air, and Outdoor Air Temperature Sensors.

Standard Unit Controller

- An Integrated Low-Ambient Control, Anti-Short Cycle Protection, Lead-Lag, Fan On and Fan off Delays, Low Voltage Protection, Allows all units to operate in the cooling mode down to 0 °F outdoor ambient without additional components or intervention.
- Safety Monitoring - Monitors the high and low-pressure switches, the freezestats, the gas valve, if applicable, and the temperature limit switch on gas and electric heat units. The unit control board will alarm on ignition failures, safety lockouts and repeated limit switch trips.
- Smart Equipment Control Board
- On-Board Diagnostic and Fault Code display

Warranty

- One (1) Year Limited Warranty on the Complete Unit
- Five (5) Year Warranty - Compressors
- Ten (10) Year Warranty - Aluminized Steel Tubular Heat Exchangers

Project Name: **454B Stock**Unit Model #: **KQG06E4B1AA5A111A1**Quantity: **1**System: **KQG06E4B1AA5A111A1****Additional Electrical Data**

Power supply	460-3-60
Unit min circuit ampacity	12.2 A
Unit max over-current protection	15 A
Min Voltage	432 V
Max Voltage	504 V
Comp #1 RLA	6.6
Comp #1 LRA	60.0
Indoor Mtr Voltage	460-3-60
Indoor Mtr FLA	2.6
Outdoor Mtr Qty	1
Outdoor Fan Voltage	460-1-60
OD Fan Mtr FLA (ea.)	1.3
Power Ex Mtr Qty (if applicable)	1
Powered Ex Voltage(if applicable)	460-3-60
Power Ex Mtr FLA (ea) (if applicable)	0.5
Combustion Mtr Qty	1
Combustion Motor Voltage	208/230-1-60
Combustion Mtr FLA (ea)	0.5



Project Name: 454B Stock

Unit Model #: KQG06E4B1AA5A111A1

Quantity: 1

System: KQG06E4B1AA5A111A1

Factory Installed Options

KQG06E4B1AA5A111A1

Equipment Options		Option(s) Selected
Product Category:	KQ	York Sun Core Single Packaged R-454B Air Conditioner
Heat Type:	G	Gas Heat
Nominal Cooling Capacity:	06	5 Ton Single Stage Cooling 14.0 SEER2 / 12.0 EER2
Heat Size:	E	112 MBH Single Stage Input Medium Heat Aluminized Gas
Voltage:	4	460-3-60
Airflow:	B	Medium Static Belt Drive Blower
Airflow Options:	1	
Controls:	A	Smart Equipment Controller including Discharge Air, Return Air, and Outdoor Air Temperature Sensors.
Sensor Options:	5	Refrigerant Detection System
Economizer / Damper:	A	
Convenience Outlet:	1	
Electrical Options:	1	
Cabinet Options:	1	
Special Options:	A	
Product Generation:	1	



YORK®

3-12.5 York® Sun™ Core

Page: 101

Project Name: 454B Stock


Unit Model #: KQG06E4B1AA5A111A1

Quantity: 1

ZQ 06 Unit Dimensions

ZQ06

TONNAGE	U I	OPERATING WEIGHT (LBS) (BASE UNIT)	CENTER OF GRAVITY LOCATION (BASE UNIT)	4 POINT CORNER LOADS (LBS) (BASE UNIT)				
			X	Y	A	B	C	D
3	6	592 (268.5)	33.7 (155)	24.9 (112)	162.6 (73.8)	136.3 (61.8)	133.8 (60.5)	159.3 (72.3)
4	4	564 (255.8)	36.3 (164)	24.9 (112)	144.9 (65.7)	139.9 (63.5)	137.1 (62.2)	142 (64.4)
5	27	562 (254)	36.2 (163)	25.1 (113)	151.1 (68.6)	145.1 (65.8)	139.9 (63.5)	145.7 (66.1)
5	20	566.2 (256.8)	37.5 (171)	25.1 (113)	141.9 (64.4)	146.2 (66.4)	141 (64)	136.8 (62.1)

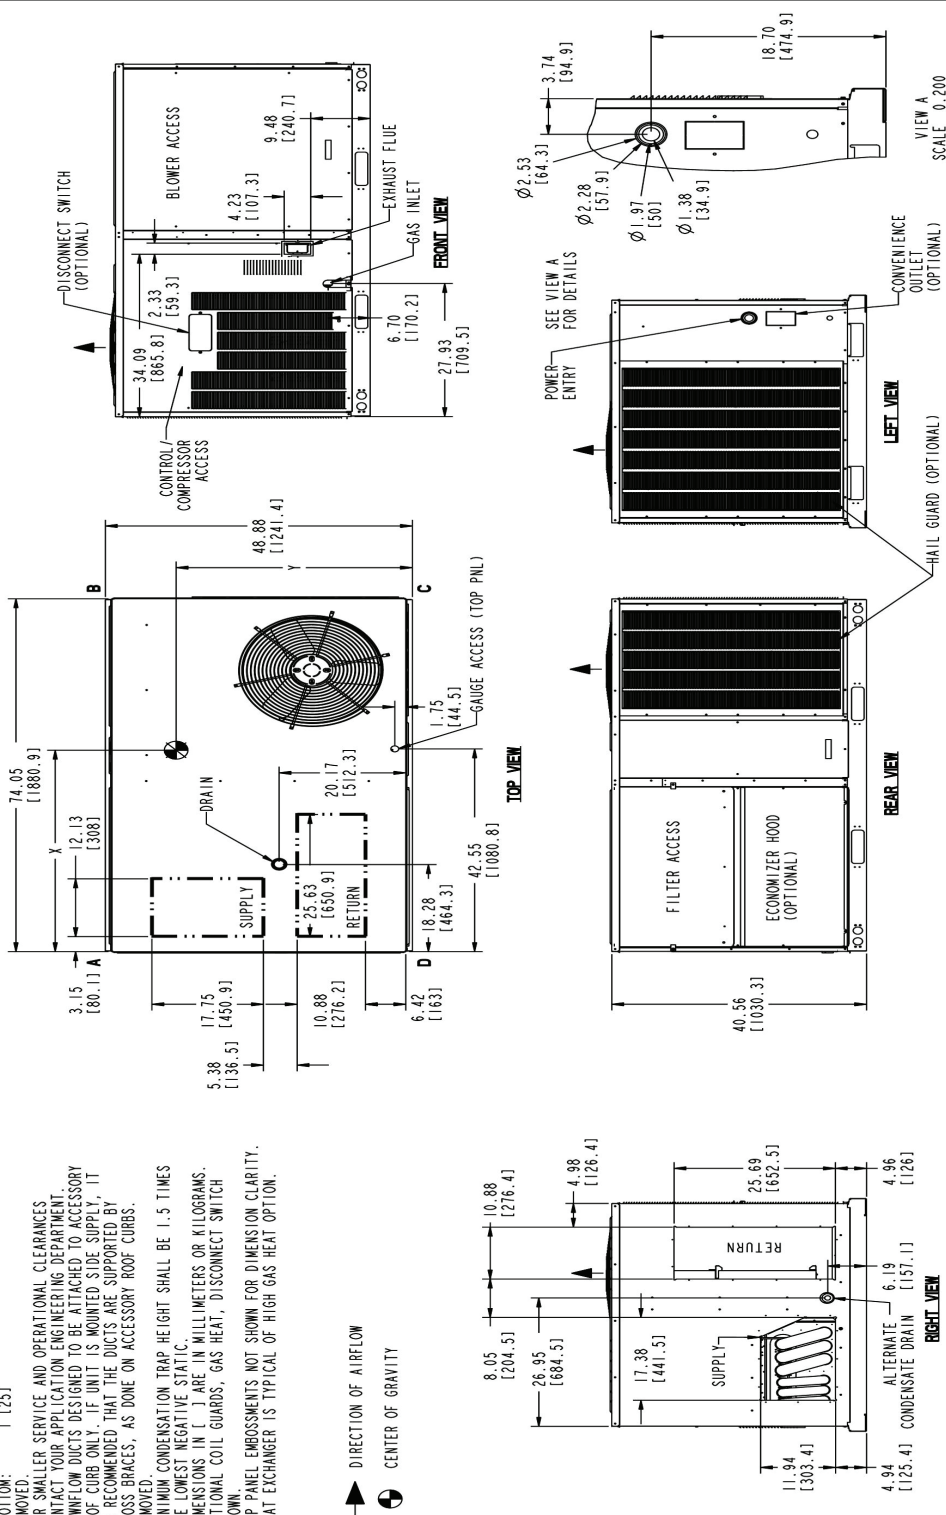

- NOTES:**
- FOR OUTDOOR USE ONLY.
 - WEIGHTS SHOWN ARE FOR COOLING ONLY UNITS.
 - RECOMMENDED MIN. CLEARANCES:
RIGHT SIDE: 18 [450] W/SIDE CONDENSATE DRAIN: 24 [600]
LEFT SIDE: 12 [300] W/PIPGAIL: 18 [450]
FRONT: 36 [900]
REAR: 18 [450] W/ECONOMIZER/POWER EXHAUST: 36 [900]
TOP: 72 [1800]
BOTTOM: 1 [25]
 - REMOVED.
 - FOR SMALLER SERVICE AND OPERATIONAL CLEARANCES
CONTACT YOUR APPLICATION ENGINEERING DEPARTMENT.
 - DOWNFLOW DUCTS DESIGNED TO BE ATTACHED TO ACCESSORY
ROOF CURB ONLY. IF UNIT IS MOUNTED SIDE SUPPLY, IT
IS RECOMMENDED THAT THE DUCTS ARE SUPPORTED BY
CROSS BRACES, AS DONE ON ACCESSORY ROOF CURBS.
 - REMOVED.
 - MINIMUM CONDENSATION TRAP HEIGHT SHALL BE 1.5 TIMES
THE LOWEST NEGATIVE STATIC.
 - DIMENSIONS IN () ARE IN MILLIMETERS OR KILOGRAMS.
 - OPTIONAL COIL GUARDS, GAS HEAT, DISCONNECT SWITCH
SHOWN.
 - TOP PANEL EMBOSSEMENTS NOT SHOWN FOR DIMENSION CLARITY.
 - HEAT EXCHANGER IS TYPICAL OF HIGH GAS HEAT OPTION.



REV	DATE	REVISION RECORD	EC NO	DR	CH	ENG	THIRD ANGLE PROJECTION	SAFETY AND TEST
A	10-13-13	NEW DRAWING	27375	RGG	JC	DM		1. SAFETY AND TEST
B	12-03-14	REVISE CLEARANCES (NOTE 3), REMOVE EXTRA DIMS FROM VIEW A	37128	RGG	TPS	ALR		2. PERFORMANCE TESTS PER
C	05-10-16	ADDED ADDITIONAL ROW TO TABLE FOR 20 UNIT 5 TON	44829	RG	RG	ALR		3. MATERIAL
D	10-25-16	CORRECTED 4 POINT CORNER LOAD TABLE, CORRECTED CORNER CALL OUTS ON PRINT		ZAW	TR	TR		4. TYPE NOT APPLICABLE
								5. ENG SPEC NOT APPLICABLE
								6. SIZE
								7. REV
								8. UNIT-COR-100FST
								9. PART NO.
								10. SHEET NO. OF 1


Unit Model #: KQG06E4B1AA5A111A1

1

Submittal

TONNAGE	ID	OPERATING WEIGHT (LBS.)	CENTER OF GRAVITY LOCATION (BASE UNIT)		4 POINT CORNER LOADS (LBS.) (BASE UNIT)			
			X	Y	A	B	C	D
4	RL	542 (225.8)	36 (191.4)	26 (140.4)	153 (69.4)	145 (65.8)	130 (59)	137 (62.1)
5	KL	582 (264)	37 (199.8)	24 (169.6)	141 (64)	142 (64.4)	150 (68)	149 (67.1)
6	KLA	614 (274.5)	36 (191.4)	24 (169.6)	140 (63.5)	134 (60.8)	147 (66.7)	147 (66.7)
5	KV	582 (264)	34 (187.4)	25.3 (164.3)	168 (76.2)	146 (66.2)	130 (63.5)	160 (72.6)
4	KL	542 (225.8)	36.3 (192.2)	24.9 (163.2)	144.9 (65.7)	139.9 (63.5)	137.1 (62.2)	142 (64.4)
5	KV	582 (264)	36.2 (191.9)	25.1 (163.8)	151.1 (68.6)	145.1 (65.8)	135.9 (63.5)	145.7 (66.1)

1. FOR OUTDOOR USE ONLY.
2. WEIGHTS SHOWN ARE FOR COOLING ONLY UNITS.
3. RECOMMENDED MIN. CLEARANCES:
 - RIGHT SIDE: 18 [450] W/SIDE CONDENSATE DRAIN: 24 [600]
 - LEFT SIDE: 12 [300] W/PITAIL: 18 [450]
 - FRONT: 36 [900]
 - REAR: 18 [450] W/ECONOMIZER/POWER EXHAUST: 36 [900]
 - TOP: 72 [1800]
 - BOTTOM: 12 [300]
4. FOR SMALLER SERVICE AND OPERATIONAL CLEARANCES CONTACT YOUR APPLICATION ENGINEERING DEPARTMENT.
5. DOWNFLOW DUCTS DESIGNED TO BE ATTACHED TO ACCESSORY ROOF CURB ONLY. IF UNIT IS MOUNTED SIDE SUPPLY, IT IS RECOMMENDED THAT THE DUCTS ARE SUPPORTED BY CROSS BRACES, AS DONE ON ACCESSORY ROOF CURBS.
6. MINIMUM CONDENSATION TRAP HEIGHT SHALL BE 1.5 TIMES THE LOWEST NEGATIVE STATIC.
7. DIMENSIONS IN [] ARE IN MILLIMETERS OR KILOGRAMS.
8. OPTIONAL COIL GUARDS, GAS HEAT, DISCONNECT SWITCH SHOWN.
9. TOP PANEL EMBOSSEMENTS NOT SHOWN FOR DIMENSION CLARITY.
10. HEAT EXCHANGER IS TYPICAL OF HIGH GAS HEAT OPTION.

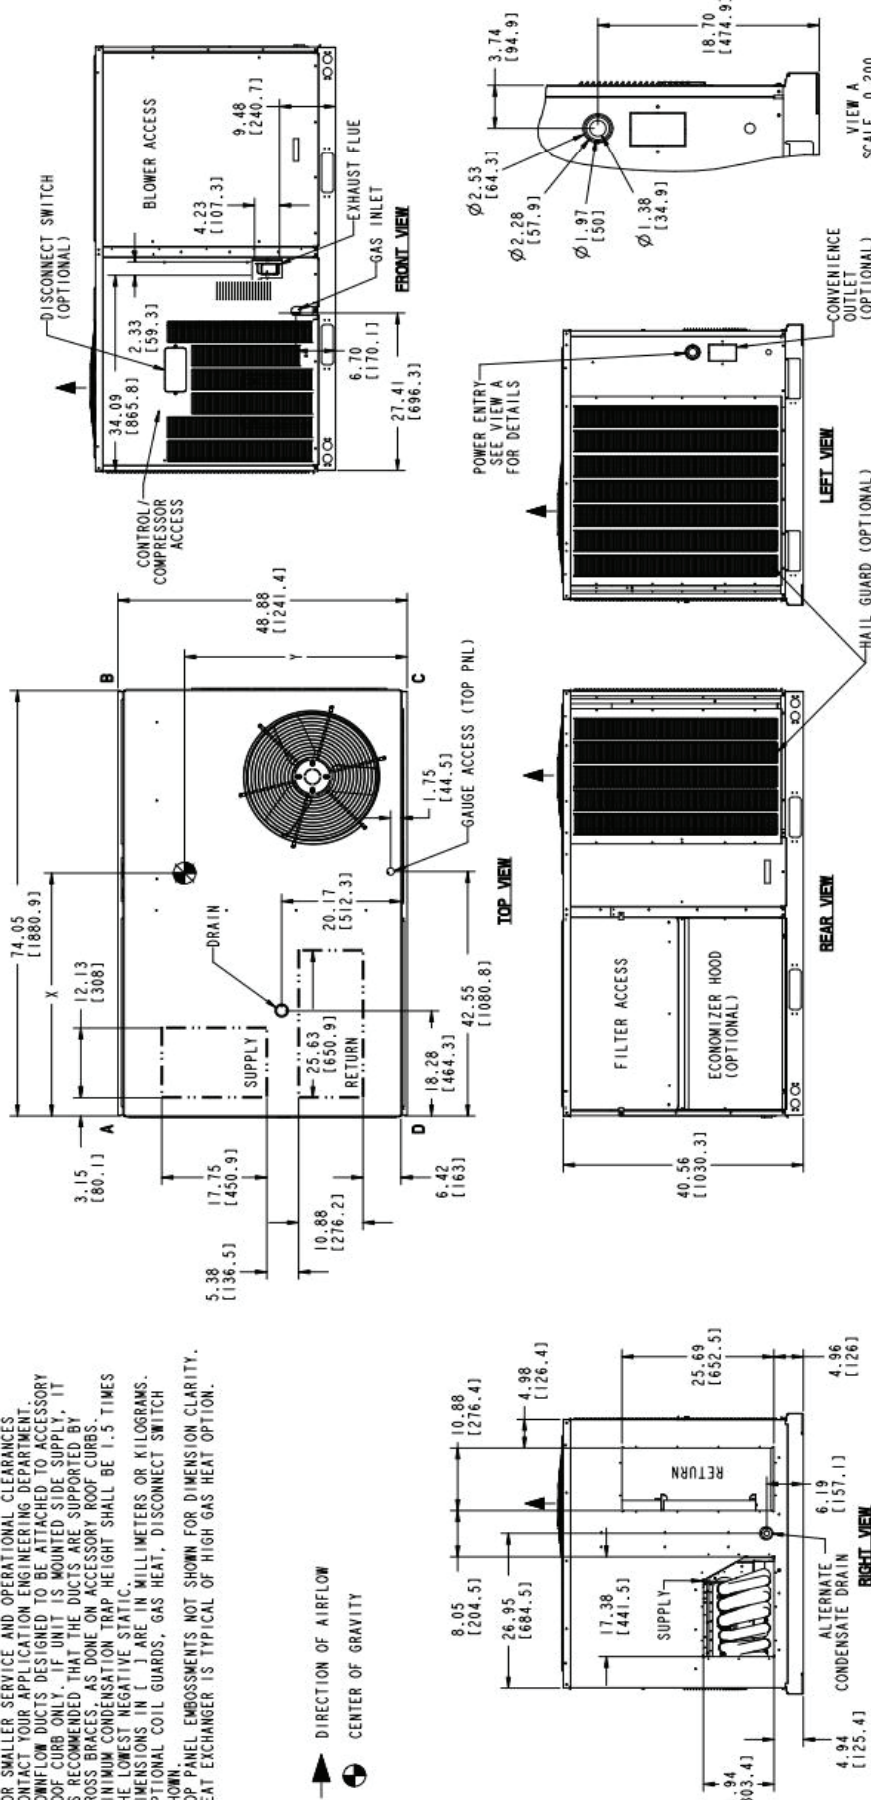

REV	DATE	REVISION RECORD				THIRD ANGLE PROJECTION		DRAWING PER ASME Y14.5-2009		ALL DIMENSIONS UNLESS OTHERWISE SPECIFIED ARE IN INCHES AND DECIMALS THEREOF. THIS DRAWING IS THE PROPERTY OF THE COMPANY AND IS NOT TO BE REPRODUCED OR COPIED WITHOUT WRITTEN PERMISSION FROM THE COMPANY.		SAFETY AND HEALTH CHARACTERISTICS PER SECTION 310-8.1																							
A	02-20-24	NEW DRAWING (FROM 5901136)				EC NO	DR	CX	ENG	101149	RCH	MJP	BV	SUBMITTAL DATA DWG, CORE I ODF, 40.5" CAB		THEY NOT APPLICABLE		WATER		SITE NO.		PART NO.		REV		A									
														ONE PLACE DECIMAL = ± .1																					
														TWO PLACE DECIMAL = ± .03																					
														THREE PLACE DECIMAL = ± .010																					
														FOUR PLACE DECIMAL = ± .005																					
														FIVE PLACE DECIMAL = ± .0005																					
														SIX PLACE DECIMAL = ± .00005																					
														SEVEN PLACE DECIMAL = ± .000005																					
														EIGHT PLACE DECIMAL = ± .0000005																					
														NINE PLACE DECIMAL = ± .00000005																					
														TEN PLACE DECIMAL = ± .000000005																					
														ELEVEN PLACE DECIMAL = ± .0000000005																					
														TWELVE PLACE DECIMAL = ± .00000000005																					
														THIRTEEN PLACE DECIMAL = ± .000000000005																					
														FOURTEEN PLACE DECIMAL = ± .0000000000005																					
														FIFTEEN PLACE DECIMAL = ± .00000000000005																					
														SIXTEEN PLACE DECIMAL = ± .000000000000005																					
														SEVENTEEN PLACE DECIMAL = ± .0000000000000005																					
														EIGHTEEN PLACE DECIMAL = ± .00000000000000005																					
														NINETEEN PLACE DECIMAL = ± .000000000000000005																					
														TWENTY PLACE DECIMAL = ± .0000000000000000005																					
														TWENTY-ONE PLACE DECIMAL = ± .00000000000000000005																					
														TWENTY-TWO PLACE DECIMAL = ± .000000000000000000005																					
														TWENTY-THREE PLACE DECIMAL = ± .0000000000000000000005																					
														TWENTY-FOUR PLACE DECIMAL = ± .00000000000000000000005																					
														TWENTY-FIVE PLACE DECIMAL = ± .000000000000000000000005																					
														TWENTY-SIX PLACE DECIMAL = ± .0000000000000000000000005																					
														TWENTY-SEVEN PLACE DECIMAL = ± .00000000000000000000000005																					
														TWENTY-EIGHT PLACE DECIMAL = ± .000000000000000000000000005																					
														TWENTY-NINE PLACE DECIMAL = ± .0000000000000000000000000005																					
														THIRTY PLACE DECIMAL = ± .00000000000000000000000000005																					
														THIRTY-ONE PLACE DECIMAL = ± .000000000000000000000000000005																					
														THIRTY-TWO PLACE DECIMAL = ± .0000000000000000000000000000005																					
														THIRTY-THREE PLACE DECIMAL = ± .00000000000000000000000000000005																					
														THIRTY-FOUR PLACE DECIMAL = ± .000000000000000000000000000000005																					
														THIRTY-FIVE PLACE DECIMAL = ± .0000000000000000000000000000000005																					
														THIRTY-SIX PLACE DECIMAL = ± .00000000000000000000000000000000005																					
														THIRTY-SEVEN PLACE DECIMAL = ± .000000000000000000000000000000000005																					
														THIRTY-EIGHT PLACE DECIMAL = ± .0000000000000000000000000000000000005																					
														THIRTY-NINE PLACE DECIMAL = ± .00000000000000000000000000000000000005																					
														FORTY PLACE DECIMAL = ± .000000000000000000000000000000000000005																					
														FORTY-ONE PLACE DECIMAL = ± .0000000000000000000000000000000000000005																					
														FORTY-TWO PLACE DECIMAL = ± .005																					
														FORTY-THREE PLACE DECIMAL = ± .0005																					
														FORTY-FOUR PLACE DECIMAL = ± .005																					
														FORTY-FIVE PLACE DECIMAL = ± .0005																					
														FORTY-SIX PLACE DECIMAL = ± .005																					
														FORTY-SEVEN PLACE DECIMAL = ± .0005																					
														FORTY-EIGHT PLACE DECIMAL = ± .005																					
														FORTY-NINE PLACE DECIMAL = ± .0005																					
														FIFTY PLACE DECIMAL = ± .005																					
														FIFTY-ONE PLACE DECIMAL = ± .0005																					
														FIFTY-TWO PLACE DECIMAL = ± .005																					
														FIFTY-THREE PLACE DECIMAL = ± .0005																					
														FIFTY-FOUR PLACE DECIMAL = ± .005																					
														FIFTY-FIVE PLACE DECIMAL = ± .0005																					
														FIFTY-SIX PLACE DECIMAL = ± .005																					
														FIFTY-SEVEN PLACE DECIMAL = ± .0005																					
														FIFTY-EIGHT PLACE DECIMAL = ± .005																					
														FIFTY-NINE PLACE DECIMAL = ± .0005																					
														SIXTY PLACE DECIMAL = ± .005																					
														SIXTY-ONE PLACE DECIMAL = ± .0005																					
														SIXTY-TWO PLACE DECIMAL = ± .005																					
														SIXTY-THREE PLACE DECIMAL = ± .0005																					
														SIXTY-FOUR PLACE DECIMAL = ± .005																					
														SIXTY-FIVE PLACE DECIMAL = ± .0005																					
														SIXTY-SIX PLACE DECIMAL = ± .005																					
														SIXTY-SEVEN PLACE DECIMAL = ± .0005																					
														SIXTY-EIGHT PLACE DECIMAL = ± .005																					
														SIXTY-NINE PLACE DECIMAL = ± .0005																					
														SEVENTY PLACE DECIMAL = ± .005																					
														SEVENTY-ONE PLACE DECIMAL = ± .0005																					
														SEVENTY-TWO PLACE DECIMAL = ± .005																					
														SEVENTY-THREE PLACE DECIMAL = ± .0005																					
														SEVENTY-FOUR PLACE DECIMAL = ± .005																					
														SEVENTY-FIVE PLACE DECIMAL = ± .0005																					
														SEVENTY-SIX PLACE DECIMAL = ± .005																					
														SEVENTY-SEVEN PLACE DECIMAL = ± .0005																					
														SEVENTY-EIGHT PLACE DECIMAL = ± .005																					
														SEVENTY-NINE PLACE DECIMAL = ± .0005																					
														EIGHTY PLACE DECIMAL = ± .005																					
														EIGHTY-ONE PLACE DECIMAL = ± .0005																					
														EIGHTY-TWO PLACE DECIMAL = ± .005																					
														EIGHTY-THREE PLACE DECIMAL = ± .005																					
														EIGHTY-FOUR PLACE DECIMAL = ± .0005																					
														EIGHTY-FIVE PLACE DECIMAL = ± .00000000000000000000000																					