

Project Name: **454B Stock**

Unit Model #: **KV20N3CP4A1AAA81A1**

Quantity: **1**

System: **KV20N3CP4A1AAA81A1**

Cooling Performance

Total gross capacity	255.4 MBH
Sensible gross capacity	171.0 MBH
Efficiency (at ARI)	10.80 EER
Integrated eff. (at ARI)	14.00 IEER
Ambient DB temp.	95.0 °F
Entering DB temp.	80.0 °F
Entering WB temp.	67.0 °F
Evap Coil Leaving DB temp.	60.2 °F
Evap Coil Leaving WB temp.	57.0 °F
Unit Leaving DB temp.	61.6 °F
Unit Leaving WB temp.	57.4 °F
Leaving air temp dew point	54.90 °F
Sound power	82 dB(a)

Refrigerant

Refrigerant type	R-454B
Sys1	10 lb
Sys2	10 lb 12 oz

Gas Heating Performance

Entering DB temp.	60 °F
Heating output capacity (Max)	324.0 MBH
Supply air	8000 cfm
Heating input capacity (Max)	400 MBH
Leaving DB temp.	97.5 °F
Air temp. rise	37.5 °F
SSE	81.0 %
Stages	2

Supply Air Blower Performance

Supply air	8000 cfm
Ext. static pressure	0.6 IWG
Blower speed	947 rpm
Max BHP of Motor (including service factor)	5.75 HP
Duct location	Bottom
Motor rating	5.00 HP
Actual required BHP	3.88 HP
Power input	3.62 kW
Elevation	0 ft
Drive type	BELT

Electrical Data

Power supply	460-3-60
Unit min circuit ampacity	54.4 A
Unit max over-current protection	70 A

Dimensions & Weight

Hgt 49 in	Len 144 in	Wth 89 in
Weight with factory installed options		2105 lb

Clearances

Right	42 in	Front	80 in	Rear	36 in
Top	120 in	Bottom	0 in	Left	18 in

Note: Please refer to the tech guide for listed maximum static pressures



Unit Features

- Refrigerant Detection System (RDS) is Factory Installed
- Two Stage Compressor Operation
- Two independent refrigerant circuits
- Full Perimeter Base Rails with Built in Rigging Capabilities
- 5 HP Medium Static Belt Drive Blower
- 2" Throwaway Filter
- Replacement Filters: 6 (20" x 25" x 2" or 4"). Unit accepts 2" or 4" wide filters.
- Units are provided with the selected 2-inch or 4-inch filter and can easily be converted in the field to accept either size in the standard filter rack
- Utility Connections - Gas and electrical utility locations are supplied in the unit underside as well as the side of the unit. Utility connections can be made quickly and with a minimum amount of field labor
- Copper tube/Aluminum fin evaporator coils
- Microchannel condenser coils

20 Ton

- Manufactured at an ISO 9001 Registered Facility and Each Rooftop is Completely Computer-Run Tested Prior to Shipment.

Standard Unit Controller: Smart Equipment Control Board

- An Integrated Low-Ambient Control, Anti-Short Cycle Protection, Lead-Lag, Fan On and Fan off Delays, Low Voltage Protection, On-Board Diagnostic and Fault Code Display. Allows all units to operate in the cooling mode down to 0 °F outdoor ambient without additional components or intervention.
- Safety Monitoring - Monitors the High and Low-Pressure Switches, the Freezestats, the Gas Valve, if Applicable, and the Temperature Limit Switch on Gas and Electric Heat Units. The Unit Control Board will Alarm on Ignition Failures, Safety Lockouts and Repeated Limit Switch Trips.

BAS Controller

- Smart Equipment Controller including Discharge Air, Return Air, and Outdoor Air Temperature Sensors.

Warranty

- One (1) Year Limited Warranty on the Complete Unit
- Five (5) Year Warranty - Compressors and Electric Heater Elements
- Ten (10) Year Warranty - Aluminized Steel Tubular Heat Exchangers



15 - 27.5 Ton Sun Choice

Page: 19

Project Name: **454B Stock**

Unit Model #: **KV20N3CP4A1AAA81A1**

Quantity: **1**

System: **KV20N3CP4A1AAA81A1**

Additional Electrical Data

Power supply	460-3-60
Unit min circuit ampacity	54.4 A
Unit max over-current protection	70 A
Min Voltage	416 V
Max Voltage	508 V
Comp #1 RLA	16
Comp #1 LRA	142
Comp #2 RLA	18.6
Comp #2 LRA	142
Indoor Mtr Voltage	460-3-60
Indoor Mtr FLA	9.9
Outdoor Mtr Qty	4
Outdoor Fan Voltage	460-1-60
OD Fan Mtr FLA (ea.)	1.3
Power Ex Mtr Qty (if applicable)	2
Powered Ex Voltage(if applicable)	460-1-60
Power Ex Mtr FLA (ea) (if applicable)	2.2
Combustion Mtr Qty	1
Combustion Motor Voltage	208/230-1-60
Combustion Mtr FLA (ea)	0.8



15 - 27.5 Ton Sun Choice

Page: 20

Project Name: 454B Stock

Unit Model #: KV20N3CP4A1AAA81A1

Quantity: 1

System: KV20N3CP4A1AAA81A1

Factory Installed Options

KV20N3CP4A1AAA81A1

Equipment Options		Option(s) Selected
Product Category:	K	York SunChoice Single Packaged R-454B Air Conditioner
Efficiency:	V	Standard Efficiency, Bottom Duct
Nominal Cooling Capacity:	20	20 Ton
Heat Type:	N	Natural Gas, Staged Heat
Heat Size:	3	High Heat, 400 MBH Input
Blower Option:	C	5 HP Medium Static Belt Drive Blower
Air Volume:	P	Two Stage Compressor Operation IntelliSpeed control of the VFD based on stages of cooling. Provides Single Zone VAV Fan Operation as defined by ASHRAE 90.1 section 6.4.3.10.
Voltage:	4	460-3-60
Outside Air Option:	A	
Coil Options:	1	Microchannel condenser coils Copper tube/Aluminum fin evaporator coils
Controls:	A	Smart Equipment Controller including Discharge Air, Return Air, and Outdoor Air Temperature Sensors.
Sensor Options:	A	Refrigerant Detection System
Service Options:	A	
Refrigeration:	8	
Additional Options:	1	2" Throwaway Filter
Cabinet Options:	A	Standard Cabinet Polyester SMC Drain Pan
Product Generation:	1	

Unit Model #: KV20N3CP4A1AAA81A1

KV 20T Submittal

TONNAGE	OPERATING WEIGHT (LBS) (BASE UNIT)	CENTER OF GRAVITY LOCATION (BASE UNIT)		4 POINT CORNER LOADS (LBS) (BASE UNIT)			6 POINT CORNER LOADS (LBS) (BASE UNIT)																		
		X	Y	A	B	C	D	A	B	C	D	E	F												
AV/KV20	1930 (875)	69.8	[1772.9]	49.1	[1247.1]	444	[201]	419	[190]	518	[235]	549	[249]	299	[136]	277	[126]	342	[155]	370	[168]	288	[131]	355	[161]

NOTES:

1. FOR OUTDOOR USE ONLY.
2. WEIGHTS SHOWN ARE FOR COOLING ONLY UNITS.
3. SERVICE (S) AND MINIMUM (M) CLEARANCE TO COMBUSTIBLE MATERIAL:

RIGHT (\$)	LEFT	NO ECON	NO DE	(\$)	(\$)
42				19	
[1067]				[1457]	

FRONT/HEAT ACCESS (\$)	80	[2032]
------------------------	----	--------

TOP (S)	INIT-TO-INIT (S)
[3048]	[3048]
120	120

FLOOR (M)	0	[0]
-----------	---	-----

4. FOR SMALLER SERVICE AND OPERATIONAL CLEARANCE, CONTACT YOUR APPLICATION ENGINEERING DEPARTMENT.

ROOF CURB ONLY.

7. DIMENSIONS IN [] ARE IN MILLIMETERS OR KI-

SHOWN -
A HEAT EXCHANGER IS TYPICAL OF HIGH CAP HEAT

2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100
101
102
103
104
105
106
107
108
109
110
111
112
113
114
115
116
117
118
119
120
121
122
123
124
125
126
127
128
129
130
131
132
133
134
135
136
137
138
139
140
141
142
143
144
145
146
147
148
149
150
151
152
153
154
155
156
157
158
159
160
161
162
163
164
165
166
167
168
169
170
171
172
173
174
175
176
177
178
179
180
181
182
183
184
185
186
187
188
189
190
191
192
193
194
195
196
197
198
199
200
201
202
203
204
205
206
207
208
209
210
211
212
213
214
215
216
217
218
219
220
221
222
223
224
225
226
227
228
229
230
231
232
233
234
235
236
237
238
239
240
241
242
243
244
245
246
247
248
249
250
251
252
253
254
255
256
257
258
259
260
261
262
263
264
265
266
267
268
269
270
271
272
273
274
275
276
277
278
279
280
281
282
283
284
285
286
287
288
289
290
291
292
293
294
295
296
297
298
299
300
301
302
303
304
305
306
307
308
309
310
311
312
313
314
315
316
317
318
319
320
321
322
323
324
325
326
327
328
329
330
331
332
333
334
335
336
337
338
339
340
341
342
343
344
345
346
347
348
349
350
351
352
353
354
355
356
357
358
359
360
361
362
363
364
365
366
367
368
369
370
371
372
373
374
375
376
377
378
379
380
381
382
383
384
385
386
387
388
389
390
391
392
393
394
395
396
397
398
399
400
401
402
403
404
405
406
407
408
409
410
411
412
413
414
415
416
417
418
419
420
421
422
423
424
425
426
427
428
429
430
431
432
433
434
435
436
437
438
439
440
441
442
443
444
445
446
447
448
449
450
451
452
453
454
455
456
457
458
459
460
461
462
463
464
465
466
467
468
469
470
471
472
473
474
475
476
477
478
479
480
481
482
483
484
485
486
487
488
489
490
491
492
493
494
495
496
497
498
499
500
501
502
503
504
505
506
507
508
509
510
511
512
513
514
515
516
517
518
519
520
521
522
523
524
525
526
527
528
529
530
531
532
533
534
535
536
537
538
539
540
541
542
543
544
545
546
547
548
549
550
551
552
553
554
555
556
557
558
559
560
561
562
563
564
565
566
567
568
569
570
571
572
573
574
575
576
577
578
579
580
581
582
583
584
585
586
587
588
589
590
591
592
593
594
595
596
597
598
599
600
601
602
603
604
605
606
607
608
609
610
611
612
613
614
615
616
617
618
619
620
621
622
623
624
625
626
627
628
629
630
631
632
633
634
635
636
637
638
639
640
641
642
643
644
645
646
647
648
649
650
651
652
653
654
655
656
657
658
659
660
661
662
663
664
665
666
667
668
669
670
671
672
673
674
675
676
677
678
679
680
681
682
683
684
685
686
687
688
689
690
691
692
693
694
695
696
697
698
699
700
701
702
703
704
705
706
707
708
709
710
711
712
713
714
715
716
717
718
719
720
721
722
723
724
725
726
727
728
729
730
731
732
733
734
735
736
737
738
739
740
741
742
743
744
745
746
747
748
749
750
751
752
753
754
755
756
757
758
759
760
761
762
763
764
765
766
767
768
769
770
771
772
773
774
775
776
777
778
779
780
781
782
783
784
785
786
787
788
789
790
791
792
793
794
795
796
797
798
799
800
801
802
803
804
805
806
807
808
809
810
811
812
813
814
815
816
817
818
819
820
821
822
823
824
825
826
827
828
829
830
831
832
833
834
835
836
837
838
839
840
841

3

—

2000

(OPTIONAL)

Age Group	Percentage of Respondents
18-29	~65%
30-49	~75%
50-69	~85%
70+	~90%

Country	1950	1960	1970	1980	1990	2000	2010	2020	2030	2040	2050
Japan	7.0	7.5	8.0	8.5	9.0	9.5	10.0	10.5	11.0	11.5	12.0
Germany	10.0	10.5	11.0	11.5	12.0	12.5	13.0	13.5	14.0	14.5	15.0
France	11.0	11.5	12.0	12.5	13.0	13.5	14.0	14.5	15.0	15.5	16.0
Italy	12.0	12.5	13.0	13.5	14.0	14.5	15.0	15.5	16.0	16.5	17.0
Spain	13.0	13.5	14.0	14.5	15.0	15.5	16.0	16.5	17.0	17.5	18.0
Sweden	14.0	14.5	15.0	15.5	16.0	16.5	17.0	17.5	18.0	18.5	19.0
United Kingdom	15.0	15.5	16.0	16.5	17.0	17.5	18.0	18.5	19.0	19.5	20.0
United States	16.0	16.5	17.0	17.5	18.0	18.5	19.0	19.5	20.0	20.5	21.0
Canada	17.0	17.5	18.0	18.5	19.0	19.5	20.0	20.5	21.0	21.5	22.0
China	18.0	18.5	19.0	19.5	20.0	20.5	21.0	21.5	22.0	22.5	23.0
India	19.0	19.5	20.0	20.5	21.0	21.5	22.0	22.5	23.0	23.5	24.0
South Africa	20.0	20.5	21.0	21.5	22.0	22.5	23.0	23.5	24.0	24.5	25.0
South Korea	21.0	21.5	22.0	22.5	23.0	23.5	24.0	24.5	25.0	25.5	26.0
Poland	22.0	22.5	23.0	23.5	24.0	24.5	25.0	25.5	26.0	26.5	27.0
Ukraine	23.0	23.5	24.0	24.5	25.0	25.5	26.0	26.5	27.0	27.5	28.0
Russia	24.0	24.5	25.0	25.5	26.0	26.5	27.0	27.5	28.0	28.5	29.0
Belarus	25.0	25.5	26.0	26.5	27.0	27.5	28.0	28.5	29.0	29.5	30.0
Latvia	26.0	26.5	27.0	27.5	28.0	28.5	29.0	29.5	30.0	30.5	31.0
Lithuania	27.0	27.5	28.0	28.5	29.0	29.5	30.0	30.5	31.0	31.5	32.0
Estonia	28.0	28.5	29.0	29.5	30.0	30.5	31.0	31.5	32.0	32.5	33.0
Finland	29.0	29.5	30.0	30.5	31.0	31.5	32.0	32.5	33.0	33.5	34.0
Norway	30.0	30.5	31.0	31.5	32.0	32.5	33.0	33.5	34.0	34.5	35.0
Iceland	31.0	31.5	32.0	32.5	33.0	33.5	34.0	34.5	35.0	35.5	36.0
Denmark	32.0	32.5	33.0	33.5	34.0	34.5	35.0	35.5	36.0	36.5	37.0
Netherlands	33.0	33.5	34.0	34.5	35.0	35.5	36.0	36.5	37.0	37.5	38.0
Australia	34.0	34.5	35.0	35.5	36.0	36.5	37.0	37.5	38.0	38.5	39.0
New Zealand	35.0	35.5	36.0	36.5	37.0	37.5	38.0	38.5	39.0	39.5	40.0
Portugal	36.0	36.5	37.0	37.5	38.0	38.5	39.0	39.5	40.0	40.5	41.0
Greece	37.0	37.5	38.0	38.5	39.0	39.5	40.0	40.5	41.0	41.5	42.0
Turkey	38.0	38.5	39.0	39.5	40.0	40.5	41.0	41.5	42.0	42.5	43.0
Israel	39.0	39.5	40.0	40.5	41.0	41.5	42.0	42.5	43.0	43.5	44.0
Iran	40.0										

[illegible]

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100
101
102
103
104
105
106
107
108
109
110
111
112
113
114
115
116
117
118
119
120
121
122
123
124
125
126
127
128
129
130
131
132
133
134
135
136
137
138
139
140
141
142
143
144
145
146
147
148
149
150
151
152
153
154
155
156
157
158
159
160
161
162
163
164
165
166
167
168
169
170
171
172
173
174
175
176
177
178
179
180
181
182
183
184
185
186
187
188
189
190
191
192
193
194
195
196
197
198
199
200
201
202
203
204
205
206
207
208
209
210
211
212
213
214
215
216
217
218
219
220
221
222
223
224
225
226
227
228
229
230
231
232
233
234
235
236
237
238
239
240
241
242
243
244
245
246
247
248
249
250
251
252
253
254
255
256
257
258
259
260
261
262
263
264
265
266
267
268
269
270
271
272
273
274
275
276
277
278
279
280
281
282
283
284
285
286
287
288
289
290
291
292
293
294
295
296
297
298
299
300
301
302
303
304
305
306
307
308
309
310
311
312
313
314
315
316
317
318
319
320
321
322
323
324
325
326
327
328
329
330
331
332
333
334
335
336
337
338
339
340
341
342
343
344
345
346
347
348
349
350
351
352
353
354
355
356
357
358
359
360
361
362
363
364
365
366
367
368
369
370
371
372
373
374
375
376
377
378
379
380
381
382
383
384
385
386
387
388
389
390
391
392
393
394
395
396
397
398
399
400
401
402
403
404
405
406
407
408
409
410
411
412
413
414
415
416
417
418
419
420
421
422
423
424
425
426
427
428
429
430
431
432
433
434
435
436
437
438
439
440
441
442
443
444
445
446
447
448
449
450
451
452
453
454
455
456
457
458
459
460
461
462
463
464
465
466
467
468
469
470
471
472
473
474
475
476
477
478
479
480
481
482
483
484
485
486
487
488
489
490
491
492
493
494
495
496
497
498
499
500
501
502
503
504
505
506
507
508
509
510
511
512
513
514
515
516
517
518
519
520
521
522
523
524
525
526
527
528
529
530
531
532
533
534
535
536
537
538
539
540
541
542
543
544
545
546
547
548
549
550
551
552
553
554
555
556
557
558
559
560
561
562
563
564
565
566
567
568
569
570
571
572
573
574
575
576
577
578
579
580
581
582
583
584
585
586
587
588
589
590
591
592
593
594
595
596
597
598
599
600
601
602
603
604
605
606
607
608
609
610
611
612
613
614
615
616
617
618
619
620
621
622
623
624
625
626
627
628
629
630
631
632
633
634
635
636
637
638
639
640
641
642
643
644
645
646
647
648
649
650
651
652
653
654
655
656
657
658
659
660
661
662
663
664
665
666
667
668
669
670
671
672
673
674
675
676
677
678
679
680
681
682
683
684
685
686
687
688
689
690
691
692
693
694
695
696
697
698
699
700
701
702
703
704
705
706
707
708
709
710
711
712
713
714
715
716
717
718
719
720
721
722
723
724
725
726
727
728
729
730
731
732
733
734
735
736
737
738
739
740
741
742
743
744
745
746
747
748
749
750
751
752
753
754
755
756
757
758
759
760
761
762
763
764
765
766
767
768
769
770
771
772
773
774
775
776
777
778
779
780
781
782
783
784
785
786
787
788
789
790
791
792
793
794
795
796
797
798
799
800
801
802
803
804
805
806
807
808
809
810
811
812
813
814
815
816
817
818
819
820
821
822
823
824
825
826
827
828
829
830
831
832
833
834
835
836
837
838
839
840
84

2019年12月

-	
---	--

1111

--	--

Printed 12/27/2024

Information is subject to change without notice. Check local codes.

Project Name: 454B Stock


Unit Model #: KV20N3CP4A1AAA81A1

Quantity: 1

Component Location

Unit components

Figure 1: Component location

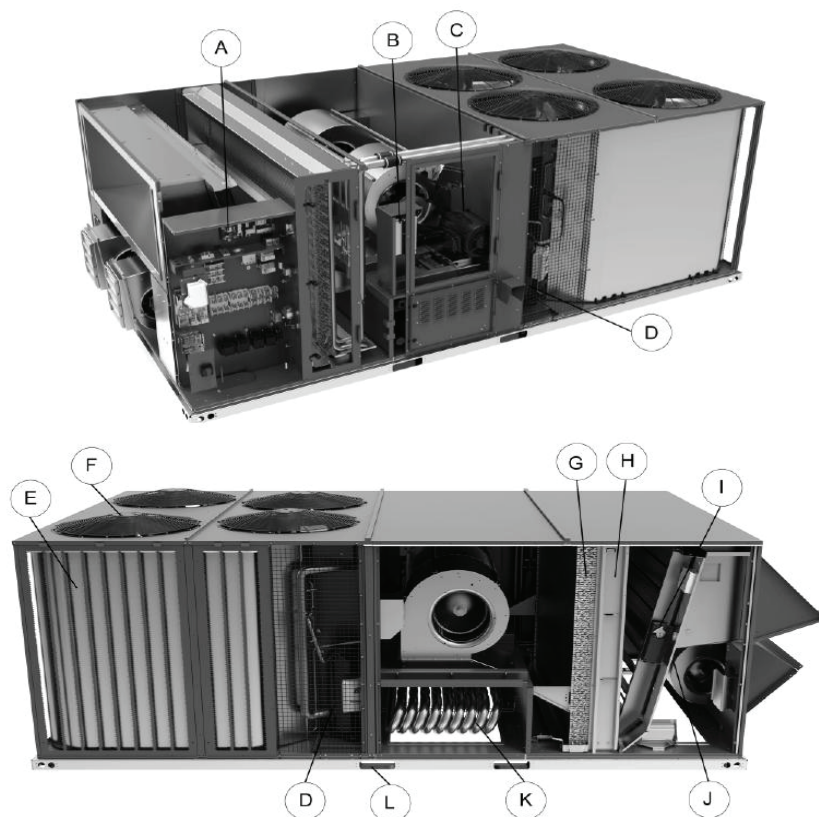

The previous figure shows the AVXX model. The following table lists the components of the unit.

Table 1: Component location table

Item	Description	Item	Description
A	Smart Equipment [™] controls	G	Copper tube/aluminum fin evaporator coil
B	Optional variable frequency drive	H	Filter access, 2-inch or 4-inch filter options
C	Belt drive blower motor with dual centrifugal fan design	I	Optional economizer. Optional manual or motorized outside air dampers not shown.
D	Scroll compressors in various arrangements to produce 2 or 4 stages of cooling depending on the selected model	J	Optional powered exhaust. Optional barometric relief not shown.
E	MicroChannel condenser coils	K	Optional staged or modulating gas heat with aluminized or stainless steel heat exchanger
F	Condenser fans	L	Full perimeter base rails with holes for overhead rigging